


OVL-ESBP BARRIER-FREE BI-LEVEL FOUNTAIN

ADDENDUM TO 96709C

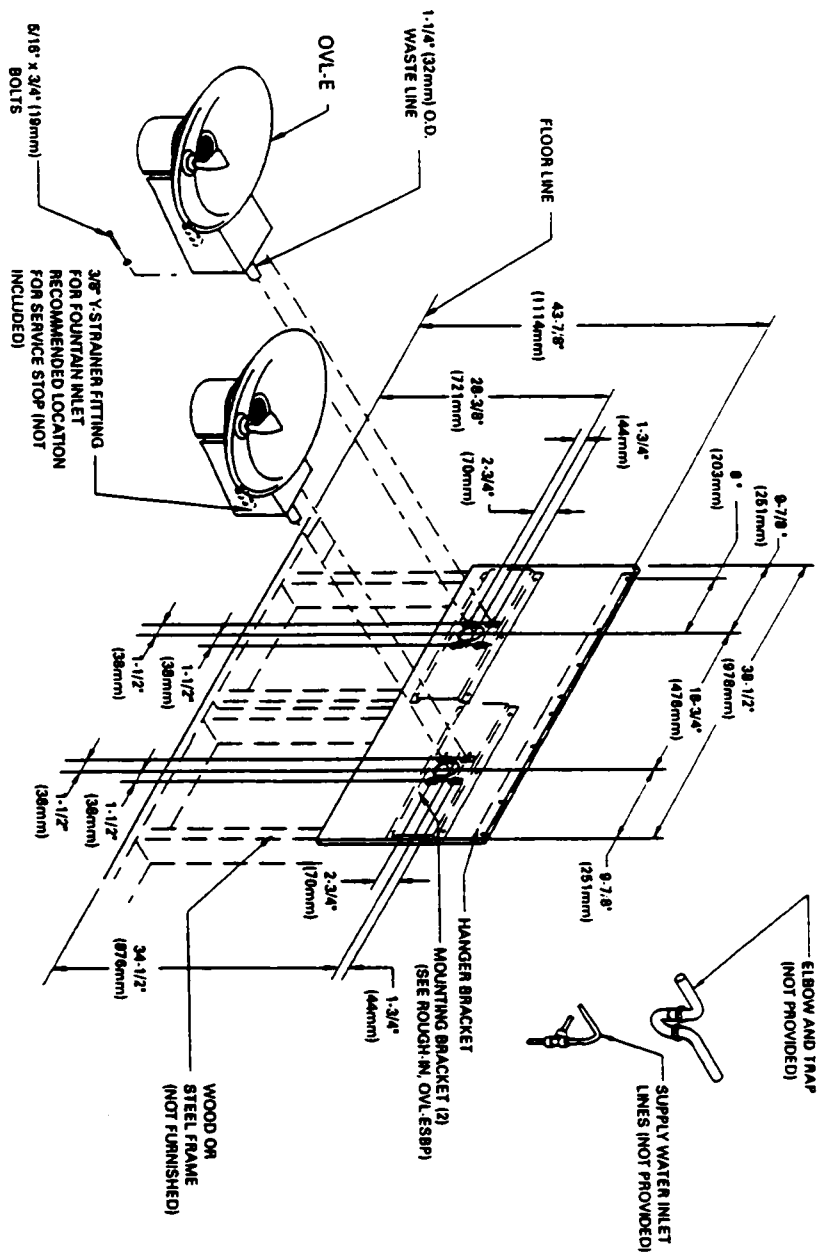

NOTE:
 DIMENSIONS SHOWN LOCATE WASTE LINE HOLE. 1-1/4" (32 mm) DIA. HOLE. INLET LINE. 7/8" (22 mm) DIA. HOLE. HANGER BRACKET AND FOUNTAIN MOUNTING HOLES
 MOUNTING HOLE DIMENSIONS ARE TYPICAL FOR BOTH OVL - E AND OVL - S FOUNTAINS

OPERATING PRESSURE:
 Supply water - 90 PSI Maximum

* 24-1/2" (622 mm) required to obtain a projector office height of 35-3/4" (908 mm) for wheelchair users. When installing this unit, LOCAL, STATE and FEDERAL CODES should be adhered to and dimensions adjusted accordingly.

ITEMIZED PARTS LIST--Same as 96709C		
page 11, except for following part:		
ITEM NO.	PART NO.	DESCRIPTION
22	22795C	Upper Panel- Stainless Steel
22	22796C	Upper Panel- Golden Bronze/stone


Harvey Taylor

P.O. BOX 9001
 OAK BROOK, IL 60521
 (708) 574-3500

MADE IN U.S.A.

FOR PARTS, CONTACT YOUR LOCAL DISTRIBUTOR OR CALL 1-800-323-0820

ROUGH-IN FOR OVL-ESBP

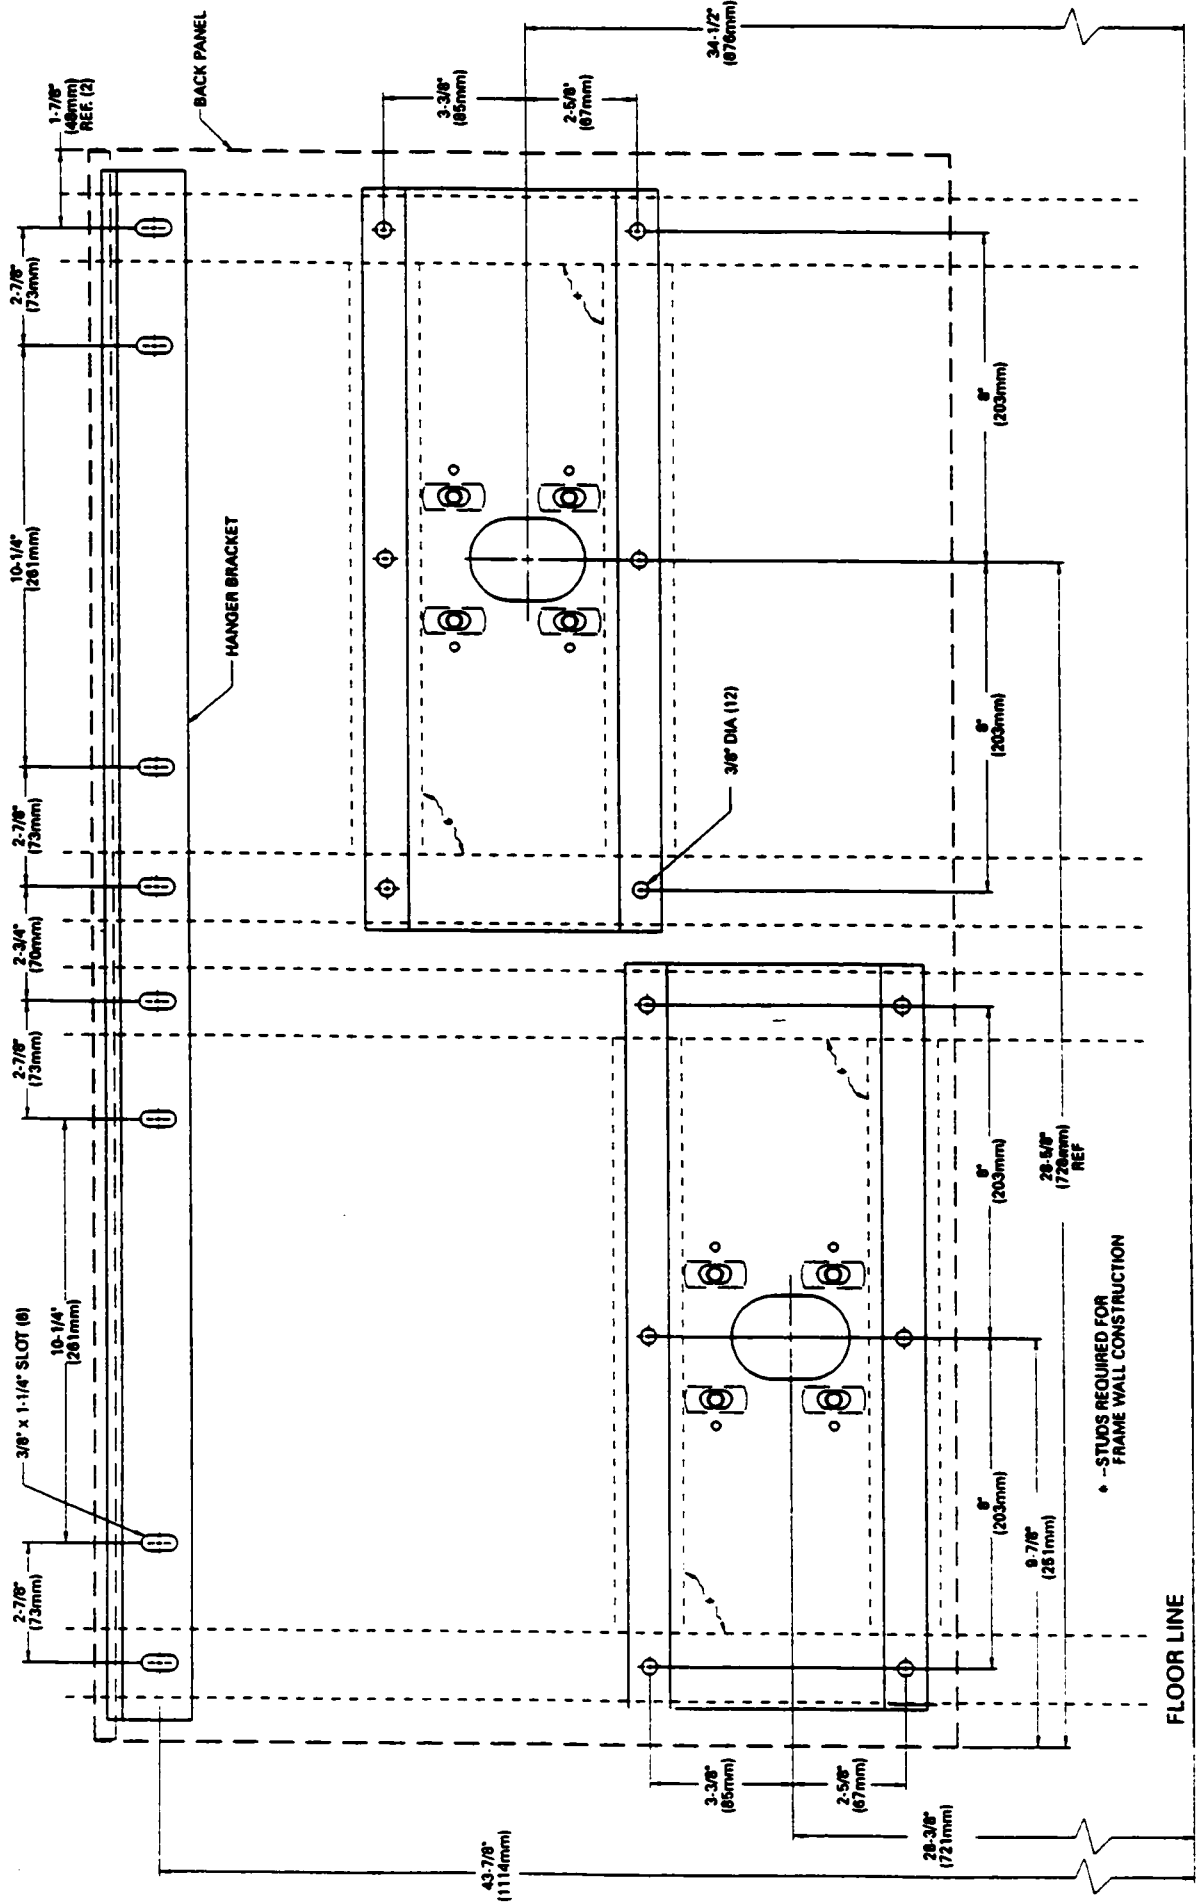

* STUDS REQUIRED FOR FRAME WALL CONSTRUCTION

FLOOR LINE